

Basic Characteristics Data

RMB

Model	Circuit method	Switching frequency [kHz]	Input current [A]	Rated input fuse	Inrush current protection	PCB/Pattern			Series/Parallel operation availability	
						Material	Single sided	Double sided	Series operation	Parallel operation
RMB15A	Flyback converter	70 - 310	0.4	125V 2A	Thermistor	CEM-3	Yes		*1	No
RMB30A	Flyback converter	50 - 310	0.8	125V 3A	Thermistor	CEM-3	Yes		*1	No
RMB50A	Flyback converter	30 - 310	1.2	125V 3A	Thermistor	CEM-3	Yes		*1	No

*1 Refer to Instruction Manual.

* Switching frequency of flyback converter depends on input voltage and load factor.

* The value of input current is at AC IN 100V and rated load.

1 Terminal Block

RMB-10

RMB

2 Function

RMB-10

- 2.1 Input voltage range RMB-10
- 2.2 Inrush current limiting RMB-10
- 2.3 Overcurrent protection RMB-10
- 2.4 Overvoltage protection RMB-10
- 2.5 Output voltage adjustment range RMB-11
- 2.6 Isolation RMB-11

3 Series Operation and Parallel Operation

RMB-11

4 Assembling and Installation Method

RMB-11

- 4.1 Installation method RMB-11
- 4.2 Derating RMB-11
- 4.3 Mounting screw RMB-12


5 Peak Loading

RMB-12


1 Terminal Block

RMB


●RMB15A

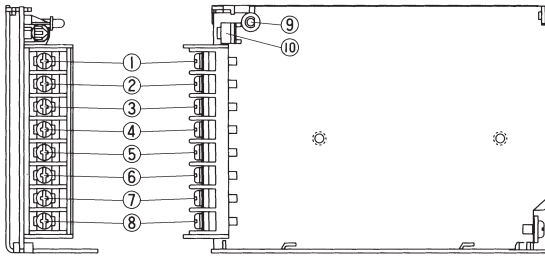

●RMB30A

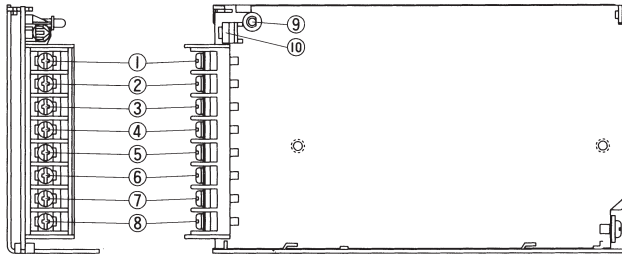

●RMB50A

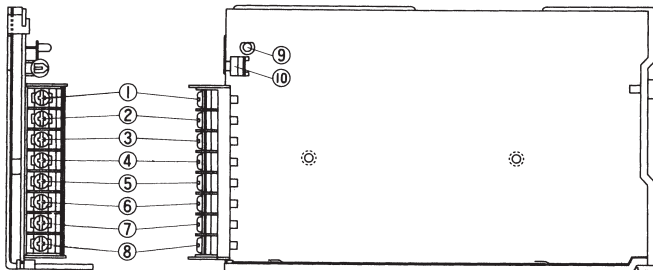

- ①V1 Output
- ②G1(V1)GND
- ③V2 Output
- ④G1(V2)GND
- ⑤NC
- ⑥Frame ground
- ⑦AC(L)
- ⑧AC(N)
- ⑨LED (+5V)
- ⑩Output voltage adjustable potentiometer (+5V)

2 Function

2.1 Input voltage range

- The range is from AC85V to AC132V or DC110V to DC170V.
- AC input voltage must have a range from AC85V to AC132V for normal operation. If the wrong input is applied, the unit will not operate properly and/or may be damaged.
- In cases that conform with safety standard, input voltage range is AC100-AC120V(50/60Hz).

2.2 Inrush current limiting


- Inrush current limiting is built-in.
- If a switch on the input side is installed, it has to be the one handling the input inrush current.
- The thermistor is used for protection from inrush current. When power is turned ON/OFF repeatedly within a short period of time, it is necessary to have enough time for power supply to cool down.

Table 2.1 Inrush current Unit:[A typ]

Model	Inrush current
RMB15A	20
RMB30A	30
RMB50A	30

2.3 Overcurrent protection

- Overcurrent protection is built-in and comes into effect at over 105% of the rated current. Overcurrent protection prevents the unit from short circuit and overcurrent condition of less than 20 sec. The unit automatically recovers when the fault condition is cleared.
- The power supply which has a current foldback characteristics may not start up when connected to nonlinear load such as lamp, motor or constant current load. See the characteristics below.

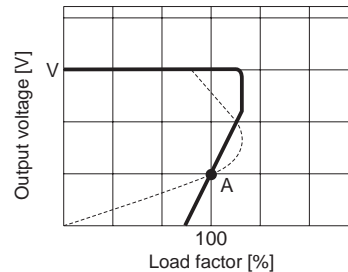

- : Load characteristics of power supply.
 - : Characteristics of load (lamp, motor, constant current load, etc.).
- Note: In case of nonlinear load, the output is locked out at A point.

Fig. 2.1 Current foldback characteristics

2.4 Overvoltage protection

●RMB15A

- Overvoltage protection circuit, clamping the output voltage by zener diode, is built-in and comes into effect at over 115% of the rated voltage. The unit in a overvoltage protection mode cannot be recovered by a user, it must be repaired at the factory. Overvoltage protection(diode)also comes into effect if the voltage is externally applied to the output side. Avoid applying voltage to the output side.

●RMB30A · RMB50A

- In V1, The overvoltage protection circuit is built-in and comes into effect at 115 - 140% of the rated voltage. The AC input should be shut down if overvoltage protection is in operation. The minimum interval of AC recycling for recovery is 2 to 3 minutes.
- ★ The recovery time varies depending on input voltage.

Remarks:

Please avoid applying the over-rated voltage to the output terminal. Power supply may operate incorrectly or fail. In case of operating a motor etc., please install an external diode on the output terminal to protect the unit.

2.5 Output voltage adjustment range

- Adjustment of output voltage for V1 is possible by using potentiometer.
- Output voltage is increased by turning potentiometer clockwise and is decreased by turning potentiometer counterclockwise.

2.6 Isolation

- For a receiving inspection, such as Hi-Pot test, gradually increase(decrease)the voltage for the start(shutdown). Avoid using Hi-Pot tester with the timer because it may generate voltage a few times higher than the applied voltage, at ON/OFF of a timer.

If the unit is tested on the isolation between input & output and output & FG, output terminals must be shorted.

3 Series Operation and Parallel Operation

- Series operation with V1 and V2 is available by connecting the output of the unit. Output current in series connection should be lower than the lowest output current of the unit.
- Series operation with other model is not possible.
- Parallel operation is not possible.

4 Assembling and Installation Method


4.1 Installation method

- When two or more power supplies are used side by side, position them with proper intervals to allow enough air ventilation. Ambient temperature around each power supply should not exceed the temperature range shown in derating curve.


4.2 Derating

- The operative ambient temperature is different by with/without case cover or mounting position. Please refer drawings as below.

●RMB15A · RMB30A

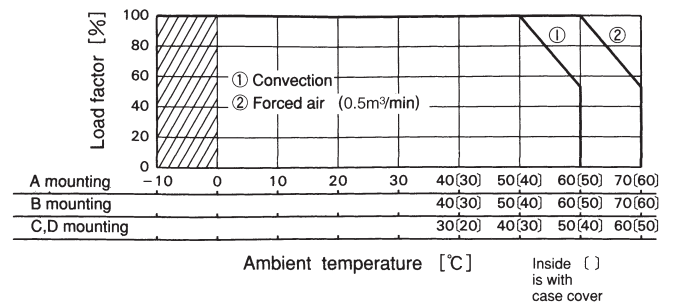

●RMB50A

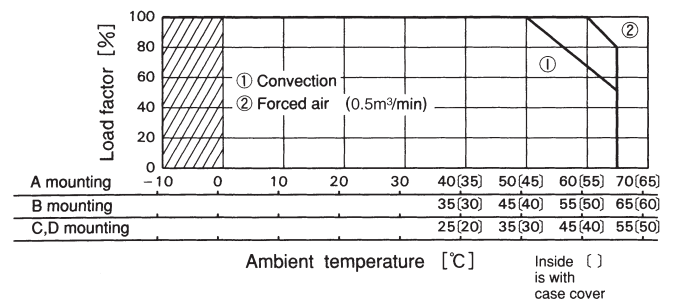


Note:

In the hatched area, the specification of Ripple, Ripple Noise is different from other area.


RMB

■When unit mounted except below drawings, it is required to consider ventilated environments by forced air cooling for temperature/load derating. For details, please consult our sales or engineering departments.

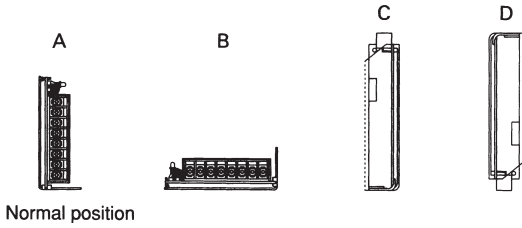

4.3 Mounting screw

■Keep isolation distance between screw and internal components as below chart.

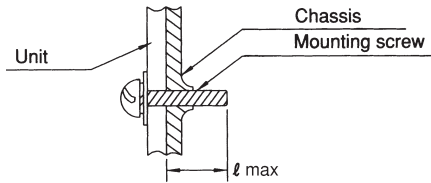

Unit:[mm]

Model	l max
RMB15A	6
RMB30A	6
RMB50A	8

5 Peak Loading

■Peak load current is possible to draw 30 seconds. It will damage devices inside the power supply when the peak load current continues more than 30 seconds.