

DATA SHEET		Date	Mar.8,2001
Model	CBS1004805/28	Temp.	25 °C
Test	Static electricity immunity test 静電気放電試験	Humid.	40 %Rh
		Tested by	S.Kinoshita

1. Method — according to EN61000-4-2 —

(1) Points to be applied voltage

電圧印加箇所

1) Input pin / Output pin / Case pin

入力ピン / 出力ピン / ケースピン

(2) Testing shall be satisfied at the lower levels given below

印加電圧はレベル1から4まで順次実施(下表参照)

(3) Change the polarity (+/-) of applied voltage

印加極性 +/- の条件でそれぞれ実施

(4) For the time interval between successive single discharges an initial value of 1s. is recommended.

On preselected points at least ten single discharges shall be applied.

1秒以上の間隔で各ポイント10回実施

(5) Contact discharge method

接触放電で実施

Test levels of EN61000-4-2

Level	1	2	3	4	X
Contact discharge [kV]	2	4	6	8	Special
Air discharge [kV]	2	4	8	15	Special

2. Conditions

(1) Input : DC48V

(2) Output : Rated output

(3) Ambient temp. : 25±10°C

3. Conditions of Acceptability

According to EN50082-2 (EN61000-4-2 Level 2)


EN50082-2(EN61000-4-2 レベル2)を満足すること

4. Result

No.	Level	Voltage [kV]	Polarity	Pin to be tested						
				+VIN	-VIN	+VOUT,+S	-VOUT,-S	Case pin	RC	TRM
1	1	2	+	OK	OK	OK	OK	OK	OK	OK
2			-	OK	OK	OK	OK	OK	OK	OK
3	2	4	+	OK	OK	OK	OK	OK	OK	OK
4			-	OK	OK	OK	OK	OK	OK	OK
5	3	6	+	OK	OK	OK	OK	OK	OK	OK
6			-	OK	OK	OK	OK	OK	OK	OK
7	4	8	+	OK	OK	OK	OK	OK	OK	OK
8			-	OK	OK	OK	OK	OK	OK	OK

All are satisfactory to item 3: OK

5. Testing circuitry

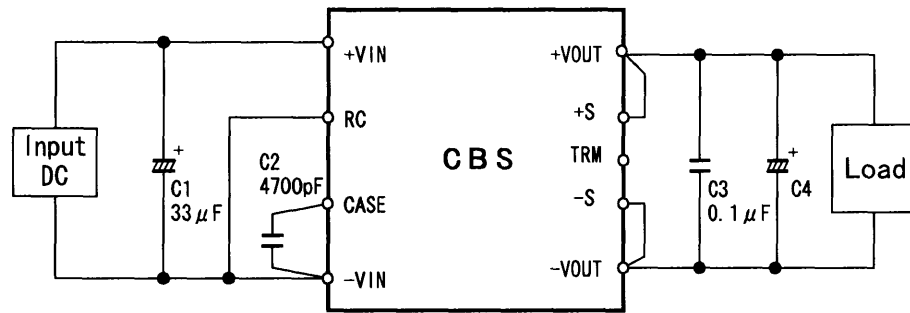

C4 : CBS1004805 2200 μ F 10V Electrolytic capacitor
CBS1004828 220 μ F 35V Electrolytic capacitor

Fig. Testing circuitry

DATA SHEET		Date	Mar.14,2001
Model	CBS2004805/12/28	Temp.	25 °C
Test	Radiated, radio-frequency, electromagnetic field immunity test 放射無線周波電磁界免疫試験	Humid.	40 %Rh
		Tested by	K.Kinoshita

1. Method — according to ENV50140 —

These tests are defined for measuring the effect that electromagnetic radiation has on the equipment connected. The tests shall be made in a shielded enclosure.

対象機器に対する電磁放射の影響を測定する。試験はシールドルームで行われること。

(1) Frequency band : 80MHz to 1000MHz

周波数範囲 : 80MHz から 1000MHz

(2) Test levels

試験レベル

Test levels of ENV50140

Level	Testing field strength V/m
1	1
2	3
3	10

2. Conditions

(1) Input : DC48V

(2) Output : Rated output

(3) Ambient temp. : 25±10°C

(4) Testing circuitry : Fig.1

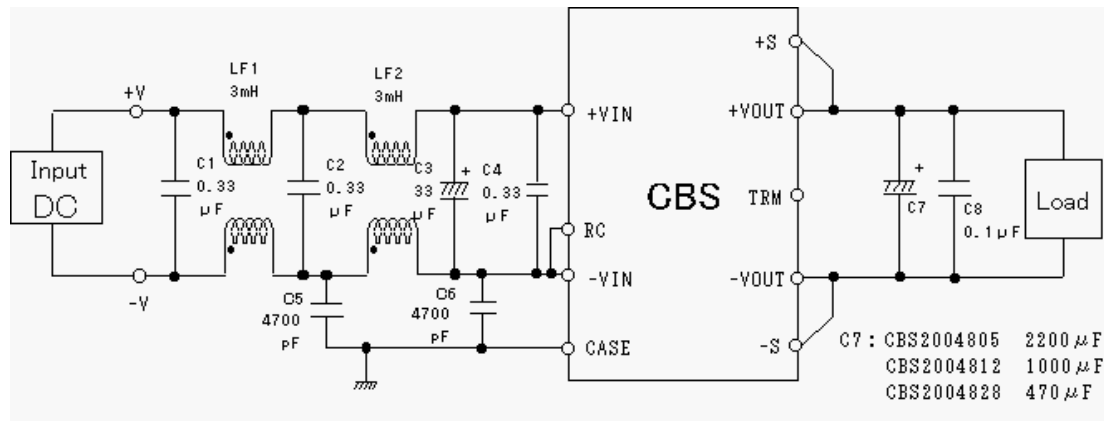


Fig.1 Testing circuitry

3. Conditions of Acceptability

According to EN50082-2 (ENV50140 Level 3)

EN50082-2 (ENV50140 レベル3)を満足すること


4. Result

No.	Level	Testing field strength[V/m]	Result
1	1	1	OK
2	2	3	OK
3	3	10	OK


All are satisfactory to item 3: OK

Test : Radiated Susceptability
 Model Name : CBS 200 48

○Photographs of Test Set-Up

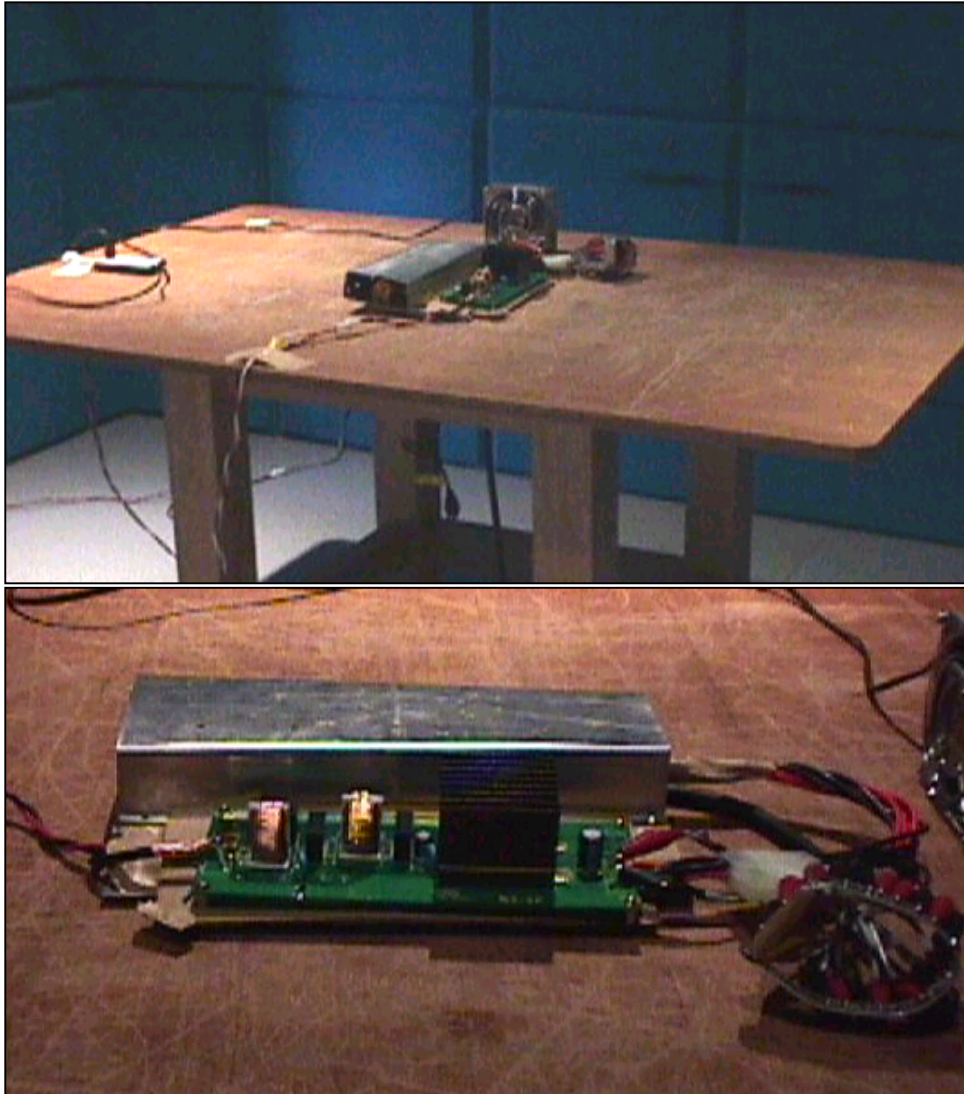

○Testing circuitry

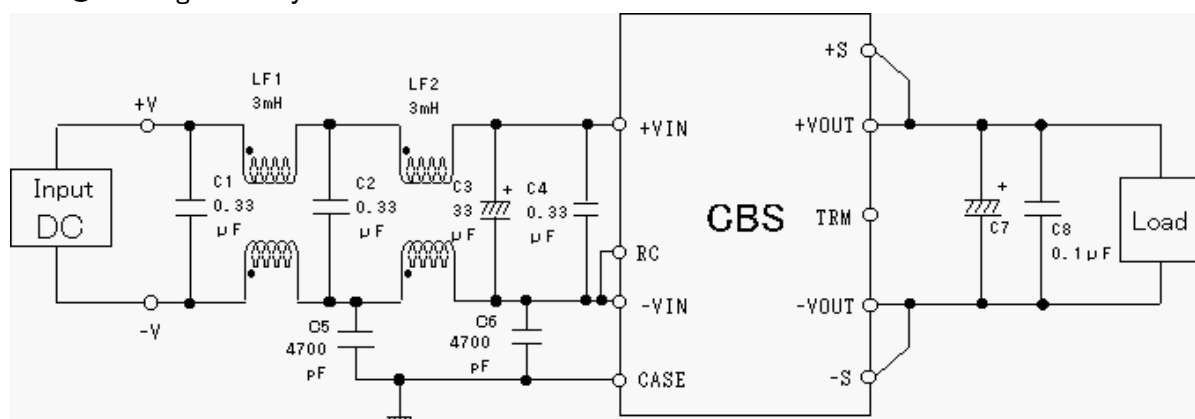

L1, L2 : SC-05-30J (TOKIN)
 C1, C2, C4 : CFJC22E334M (Nitsuko)
 C3 : 100V 33 μ F PMseries (nichicon)
 C5, C6 : DE1307-640E472M-KH (MURATA)
 C7 : CBS2004805 10V 2200 μ F LXZseries (NIPPON CHEMI-CON)
 CBS2004812 25V 1000 μ F LXZseries (NIPPON CHEMI-CON)
 CBS2004828 35V 470 μ F LXZseries (NIPPON CHEMI-CON)
 C8 : MDD21H104M (Nitsuko)

Fig. Testing circuitry

DATA SHEET		Date	Mar.8,2001
Model	CBS1004805/28	Temp.	25 °C
Test	Electrical fast transient/burst immunity test 電氣的ファーストランシエントバースト試験	Humid.	40 %Rh
		Tested by	S.Kinoshita

1. Method — according to EN61000-4-4 —

(1) Points to be applied voltage

電圧印加箇所

1) Between input pin(+VIN) and ground plane

入力ピン(+VIN) — グラントプレーン間

2) Between input pin(-VIN) and ground plane

入力ピン(-VIN) — グラントプレーン間

3) Between case pin and ground plane

ケースピン — グラントプレーン間

4) Between output pin and ground plane

出力ピン — グラントプレーン間

(2) Testing shall be satisfied at the lower levels given below

印加電圧はレベル1から4まで順次実施(下表参照)

(3) Change the polarity (+/-) of applied voltage

印加極性 +/-の条件でそれぞれ実施

(4) The period of applied voltage is 1 minute

電圧印加時間は1分間

Test levels of EN61000-4-4

Level	1	2	3	4	X
Voltage peak[kV]	0.5	1	2	4	Special
Repetition rate [kHz]	5	5	5	2.5	Special

2. Conditions

(1) Input : DC48V

(2) Output : Rated output

(3) Ambient temp. : 25±10°C

3. Conditions of Acceptability

According to EN50082-2 (EN61000-4-4 Level 3)


EN50082-2(EN61000-4-4 レベル3)を満足すること

4. Result

No.	Level	Voltage [kV]	Polarity	Pin to be tested					
				+VIN	-VIN	+VOUT,+S	-VOUT,-S	Case pin	RC
1	1	0.5	+	OK	OK	OK	OK	OK	OK
2			-	OK	OK	OK	OK	OK	OK
3	2	1	+	OK	OK	OK	OK	OK	OK
4			-	OK	OK	OK	OK	OK	OK
5	3	2	+	OK	OK	OK	OK	OK	OK
6			-	OK	OK	OK	OK	OK	OK
7	4	4	+	OK	OK	OK	OK	OK	OK
8			-	OK	OK	OK	OK	OK	OK

All are satisfactory to item 3: OK

5. Testing circuitry

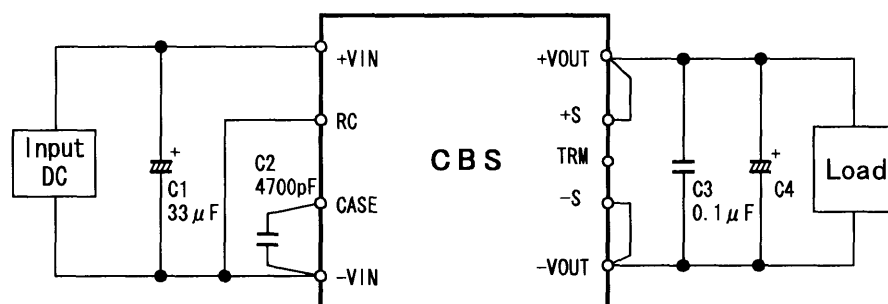

C4 : CBS1004805 2200 μF 10V Electrolytic capacitor
CBS1004828 220 μF 35V Electrolytic capacitor

Fig. Testing circuitry

DATA SHEET		Date	2001/3/7
Model	CBS1004828	Temp.	25 °C
Test	Surge immunity test サージ・immunity試験	Humid.	40 %Rh
		Tested by	H.Senda

1. Method — according to EN61000-4-5 —

(1) Points to be applied voltage

電圧印加箇所

— Line to line (ライン - ライン間 : ノーマル) —

1) Between input pin (+V) and input pin (-V)

入力ピン(+V) - 入力ピン(-V)

— Line to case pin (ライン - ケースピン間 : コモン) —

2) Between input pin (+V) and case pin

入力ピン(+V) - ケースピン

3) Between input pin (-V) and case pin

入力ピン(-V) - ケースピン

(2) Test at the selected levels shown below

印加電圧(レベル)は、下表に従う

(3) Change the polarity (+/-) of applied voltage

印加極性 +/- の条件でそれぞれ実施

(4) Number of tests : Six positive and six negative at selected points.

試験の回数 : それぞれの印加箇所、正負各6回試験する

(5) Repetition rate : maximum 1/min.

繰り返し速度 : 最大1回/分 (1分以上の間隔をおく)

Test levels of EN61000-4-5

Level	1	2	3	4
Test voltage [kV]	0.5	1	2	4

2. Conditions

(1) Input : DC48V

(2) Output : Rated output

(3) Ambient temp. : 25±10°C

(4) Testing circuitry : Refer to item 5

3. Conditions of Acceptability

Line to line : According to EN50082-2 (EN61000-4-5 Level 3)

ライン - ライン間 (ノーマル) : EN50082-2(EN61000-4-5 レベル3)を満足すること

Line to earth : According to EN50082-2 (EN61000-4-5 Level 4)

ライン - ケースピン間 (コモン) : EN50082-2(EN61000-4-5 レベル4)を満足すること


4. Result

No.	Voltage [kV]	Polarity	Line (+V) - Line (-V)
1	0.5	+	OK
2		-	OK
3	1	+	OK
4		-	OK
5	2	+	OK
6		-	OK

No.	Voltage [kV]	Polarity	Line (+V) - Case pin	Line (-V) - Case pin
1	0.5	+	OK	OK
2		-	OK	OK
3	1	+	OK	OK
4		-	OK	OK
5	2	+	OK	OK
6		-	OK	OK
7	4	+	OK	OK
8		-	OK	OK

All are satisfactory to item 3: OK

5. Testing circuitry

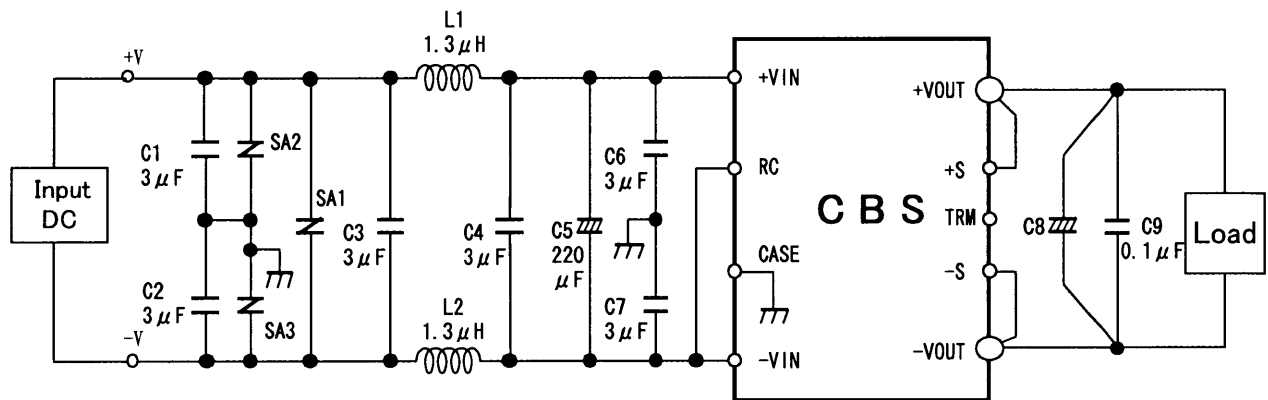

- L1, L2 : ETQP6F1R3LFA (MATSUSHITA)
 C1, C2, C3, C5, C6, C7 : CY55Y5P2A305M (TOKIN)
 C4 : 80V 220 μF PFseries (nichicon)
 C8 : CBS1004803, 05 10V 2200 μF LXZseries (NIPPON CHEMI-CON)
 CBS1004812, 15 25V 470 μF LXZseries (NIPPON CHEMI-CON)
 CBS1004824, 28 35V 220 μF LXZseries (NIPPON CHEMI-CON)
 SA1 : ERZV10D101 (MATSUSHITA)
 SA2, SA3 : ERZV07D820 (MATSUSHITA)
 C9 : MDD21H104M (Nitsuko)

Fig. Testing circuitry

DATA SHEET		Date	2001/3/7
Model	CBS1004805	Temp.	25 °C
Test	Surge immunity test サージ・immunity試験	Humid.	40 %Rh
		Tested by	H.Senda

1. Method — according to EN61000-4-5 —

(1) Points to be applied voltage

電圧印加箇所

— Line to line (ライン - ライン間 : ノーマル) —

1) Between input pin (+V) and input pin (-V)

入力ピン(+V) - 入力ピン(-V)

— Line to case pin (ライン - ケースピン間 : コモン) —

2) Between input pin (+V) and case pin

入力ピン(+V) - ケースピン

3) Between input pin (-V) and case pin

入力ピン(-V) - ケースピン

(2) Test at the selected levels shown below

印加電圧(レベル)は、下表に従う

(3) Change the polarity (+/-) of applied voltage

印加極性 +/- の条件でそれぞれ実施

(4) Number of tests : Six positive and six negative at selected points.

試験の回数 : それぞれの印加箇所、正負各6回試験する

(5) Repetition rate : maximum 1/min.

繰り返し速度 : 最大1回/分 (1分以上の間隔をおく)

Test levels of EN61000-4-5

Level	1	2	3	4
Test voltage [kV]	0.5	1	2	4

2. Conditions

(1) Input : DC48V

(2) Output : Rated output

(3) Ambient temp. : 25±10°C

(4) Testing circuitry : Refer to item 5

3. Conditions of Acceptability

Line to line : According to EN50082-2 (EN61000-4-5 Level 3)

ライン - ライン間 (ノーマル) : EN50082-2(EN61000-4-5 レベル3)を満足すること

Line to earth : According to EN50082-2 (EN61000-4-5 Level 4)

ライン - ケースピン間 (コモン) : EN50082-2(EN61000-4-5 レベル4)を満足すること


4. Result

No.	Voltage [kV]	Polarity	Line (+V) - Line (-V)
1	0.5	+	OK
2		-	OK
3	1	+	OK
4		-	OK
5	2	+	OK
6		-	OK

No.	Voltage [kV]	Polarity	Line (+V) - Case pin	Line (-V) - Case pin
1	0.5	+	OK	OK
2		-	OK	OK
3	1	+	OK	OK
4		-	OK	OK
5	2	+	OK	OK
6		-	OK	OK
7	4	+	OK	OK
8		-	OK	OK

All are satisfactory to item 3: OK

5. Testing circuitry

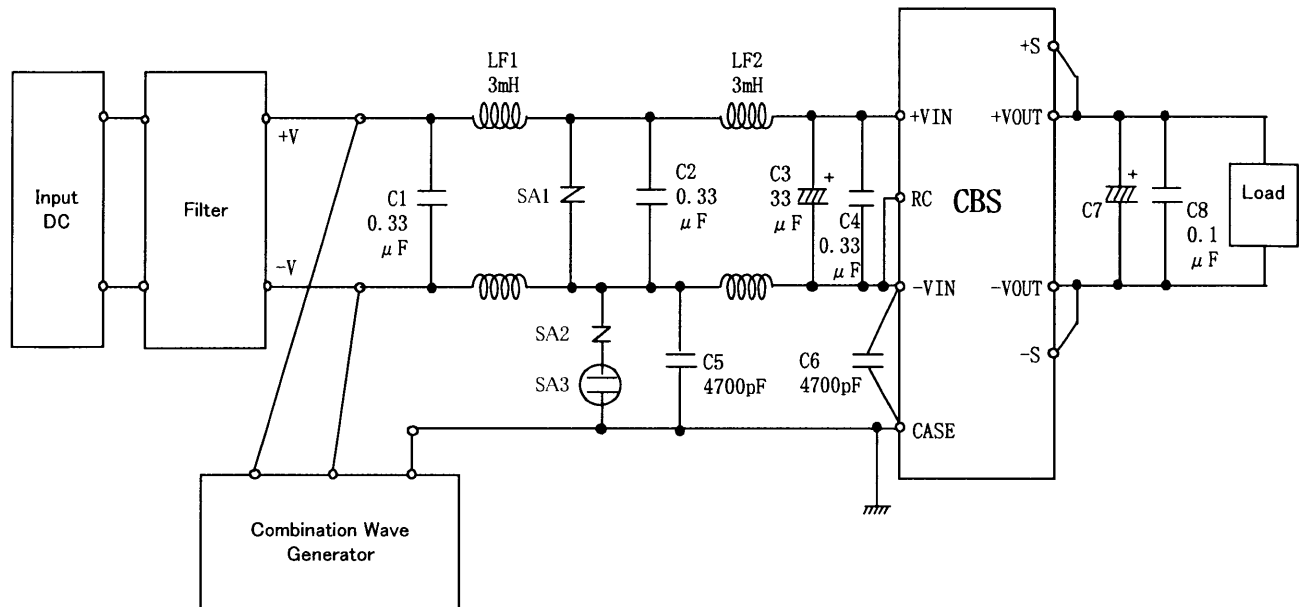

- L1、L2 : SC-05-30J (TOKIN)
- C1、C2、C4 : CFJC22E3334M (Nitsuko)
- C3 : 100V 33 μ F PMseries (nichicon)
- C5、C6 : DE1307-640E472M-KH (MURATA)
- C7 : CBS1004803, 05 10V 2200 μ F LXZseries (NIPPON CHEMI-COM)
CBS1004812, 15 25V 470 μ F LXZseries (NIPPON CHEMI-COM)
CBS1004824, 28 35V 220 μ F LXZseries (NIPPON CHEMI-COM)
- C8 : MDD21H104M (Nitsuko)
- SA1、SA2 : ERZV10D101 (MATSUSHITA)
- SA3 : DSA-302MA (MITSUBISHI)

Fig. Testing circuitry

DATA SHEET		Date	2001/3/7
Model	CBS1004828	Temp.	25 °C
Test	Surge immunity test サージ・immunity試験	Humid.	40 %Rh
		Tested by	H.Senda

1. Method — according to EN61000-4-5 —

(1) Points to be applied voltage

電圧印加箇所

— Line to line (ライン - ライン間 : ノーマル) —

1) Between input pin (+V) and input pin (-V)

入力ピン(+V) - 入力ピン(-V)

— Line to case pin (ライン - ケースピン間 : コモン) —

2) Between input pin (+V) and case pin

入力ピン(+V) - ケースピン

3) Between input pin (-V) and case pin

入力ピン(-V) - ケースピン

(2) Test at the selected levels shown below

印加電圧(レベル)は、下表に従う

(3) Change the polarity (+/-) of applied voltage

印加極性 +/- の条件でそれぞれ実施

(4) Number of tests : Six positive and six negative at selected points.

試験の回数 : それぞれの印加箇所、正負各6回試験する

(5) Repetition rate : maximum 1/min.

繰り返し速度 : 最大1回/分 (1分以上の間隔をおく)

Test levels of EN61000-4-5

Level	1	2	3	4
Test voltage [kV]	0.5	1	2	4

2. Conditions

(1) Input : DC48V

(2) Output : Rated output

(3) Ambient temp. : 25±10°C

(4) Testing circuitry : Refer to item 5

3. Conditions of Acceptability

Line to line : According to EN50082-2 (EN61000-4-5 Level 3)

ライン - ライン間 (ノーマル) : EN50082-2(EN61000-4-5 レベル3)を満足すること

Line to earth : According to EN50082-2 (EN61000-4-5 Level 4)

ライン - ケースピン間 (コモン) : EN50082-2(EN61000-4-5 レベル4)を満足すること


4. Result

No.	Voltage [kV]	Polarity	Line (+V) - Line (-V)
1	0.5	+	OK
2		-	OK
3	1	+	OK
4		-	OK
5	2	+	OK
6		-	OK

No.	Voltage [kV]	Polarity	Line (+V) - Case pin	Line (-V) - Case pin
1	0.5	+	OK	OK
2		-	OK	OK
3	1	+	OK	OK
4		-	OK	OK
5	2	+	OK	OK
6		-	OK	OK
7	4	+	OK	OK
8		-	OK	OK

All are satisfactory to item 3: OK

5. Testing circuitry

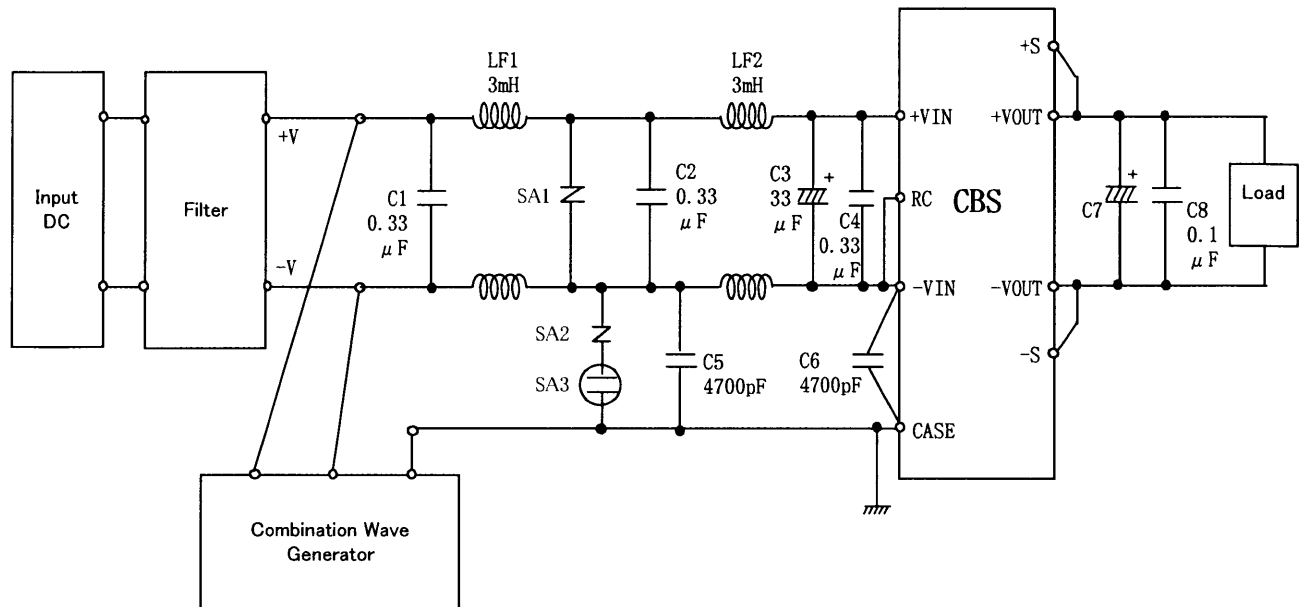

- L1、L2 : SC-05-30J (TOKIN)
 C1、C2、C4 : CFJC22E3334M (Nitsuko)
 C3 : 100V 33 μ F PMseries (nichicon)
 C5、C6 : DE1307-640E472M-KH (MURATA)
 C7 : CBS1004803, 05 10V 2200 μ F LXZseries (NIPPON CHEMI-COM)
 CBS1004812, 15 25V 470 μ F LXZseries (NIPPON CHEMI-COM)
 CBS1004824, 28 35V 220 μ F LXZseries (NIPPON CHEMI-COM)
 C8 : MDD21H104M (Nitsuko)
 SA1、SA2 : ERZV10D101 (MATSUSHITA)
 SA3 : DSA-302MA (MITSUBISHI)

Fig. Testing circuitry

DATA SHEET		Date	Mar.14,2001
Model	CBS2004805/12/28	Temp.	25 °C
Test	Immunity to conducted disturbances, induced by radio-frequency fields 伝導性無線周波数電磁界イミュニティ試験	Humid.	40 %Rh
		Tested by	K.Kinoshita

1. Method — according to ENV50141 —

(1) Points to be applied signals

信号印加箇所

1) Between input pin(+V) and input pin(-V)

入力ピン(+V) — 入力ピン(-V)間

(2) Testing shall be satisfied at the lower levels given below

印加信号はレベル1から3まで順次実施(下表参照)

Test levels of ENV50141

No.	Level	Frequency range 150kHz – 80MHz	
		Voltage level (e.m.f.)	
		Vo[dB(μV)]	Vo[V]
1	1	120	1
2	2	130	3
3	3	140	10

2. Conditions

(1) Input : DC48V

(2) Output : Rated output

(3) Ambient temp. : 25±10°C

(4) Testing circuitry : Fig.1

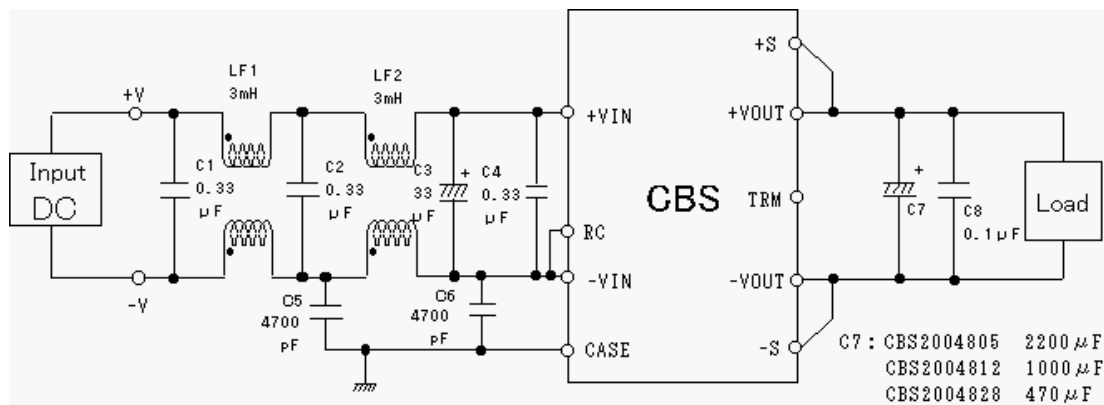


Fig.1 Testing circuitry

3. Conditions of Acceptability

According to EN50082-2 (ENV50141 Level 3) – IEC1000-4-6

EN50082-2(ENV50141 レベル3) – IEC1000-4-6を満足すること

4. Result

No.	Frequency range 150kHz – 80MHz			Result
	Level	Voltage level (e.m.f.)		
		Vo[dB(μ V)]	Vo[V]	
1	1	120	1	OK
2	2	130	3	OK
3	3	140	10	OK



All are satisfactory to item 3: OK

Conditions

Date 2001/3/12

Test : Conductive Susceptability
Model Name : CBS200

○Photographs of Test Set-Up

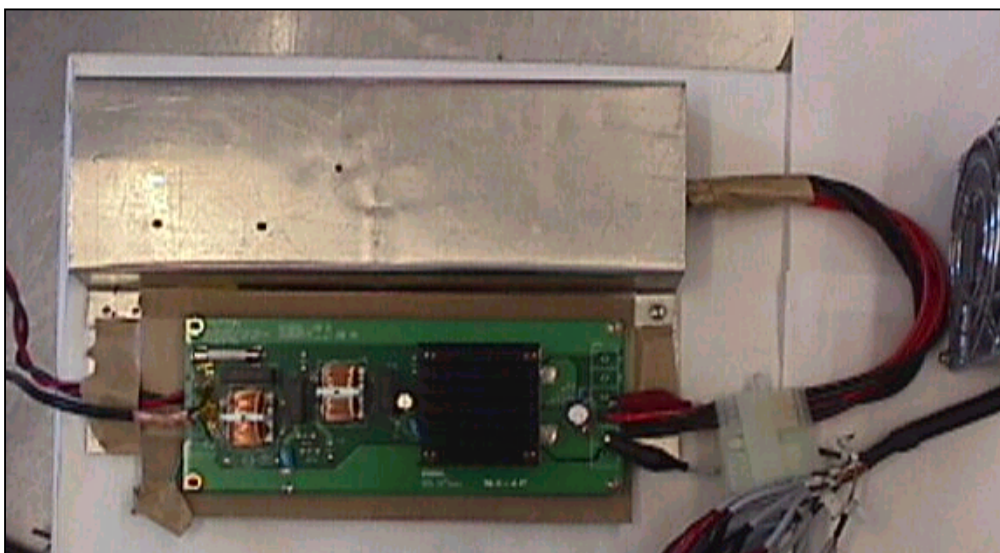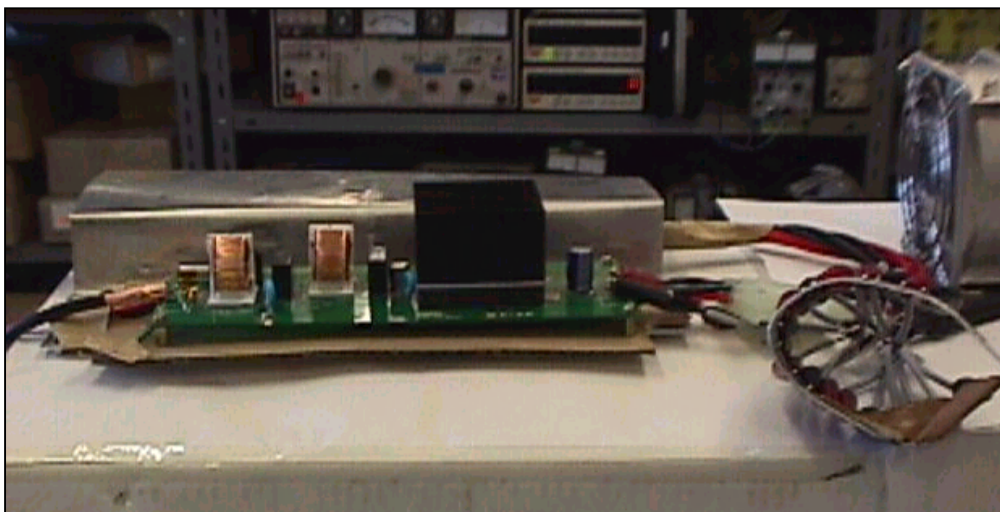

○Testing circuitry

