



EXTRA TEST DATA OF PBA100F-48

Regulated DC Power Supply
Jun, 09, 2020

COSEL CO.,LTD.






CONTENTS

1.Inrush Current (enlargement)	1
2.Dynamic Line Regulation	2
3.Ovvervoltage Protection (waveform)	3
4.Hiccup cycle (by Overcurrent Protection)	4
5.Power Consumption (by Input Voltage)	5
6.Figure of Testing Circuitry	6

(Final Page 6)




COSEL

Model	PBA100F-48	Temperature	25°C
Item	Inrush Current (enlargement)	Testing Circuitry	A
Object	_____		

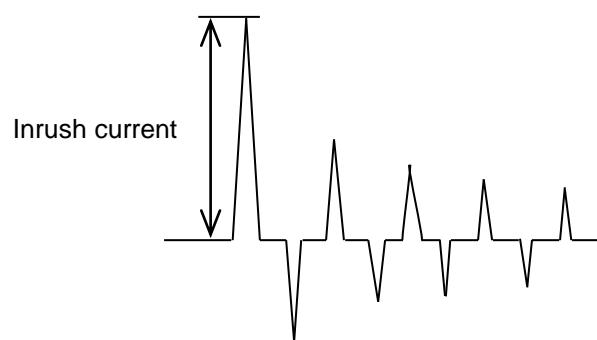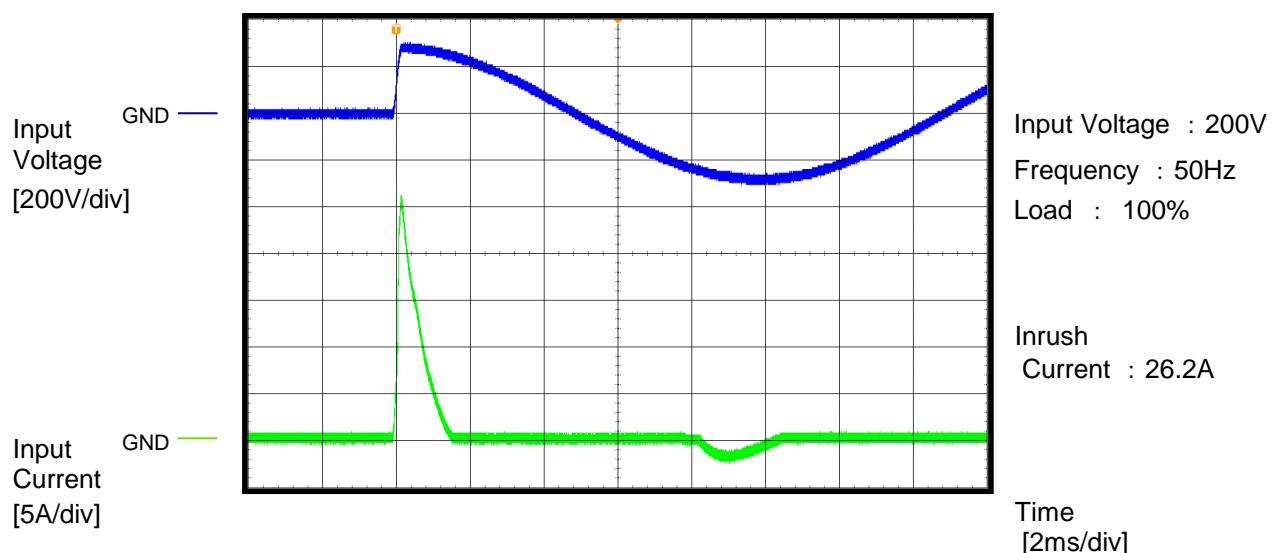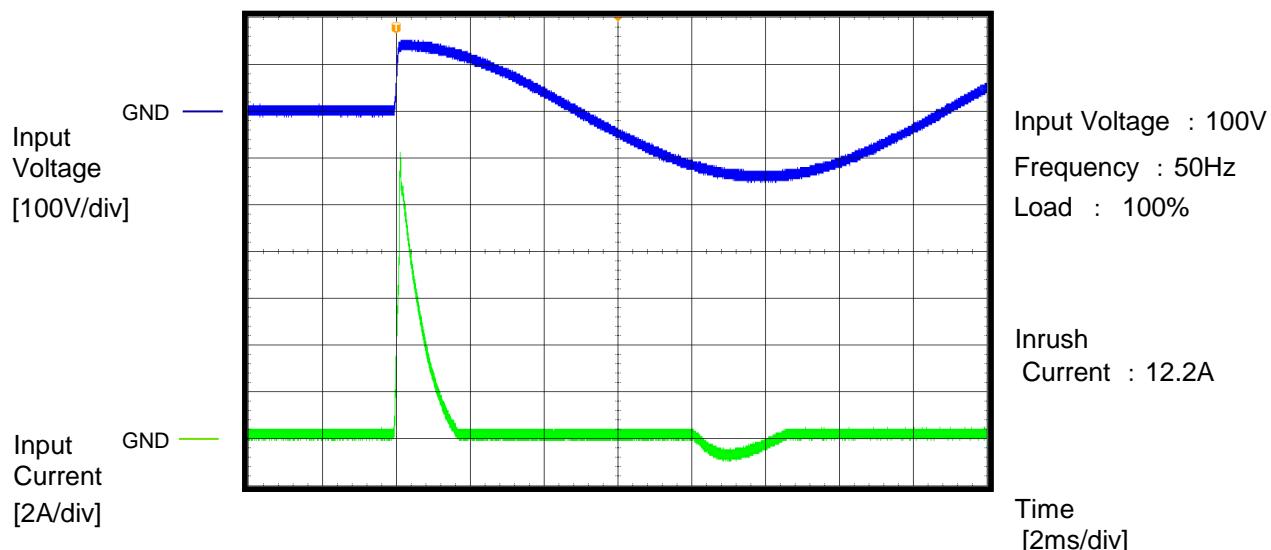




COSEL

Model	PBA100F-48	Temperature	25°C
Item	Dynamic Line Regulation	Testing Circuitry	A
Object	_____		

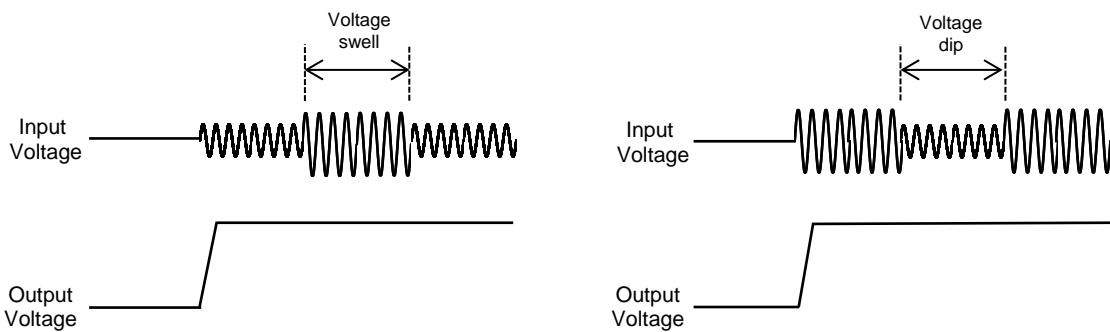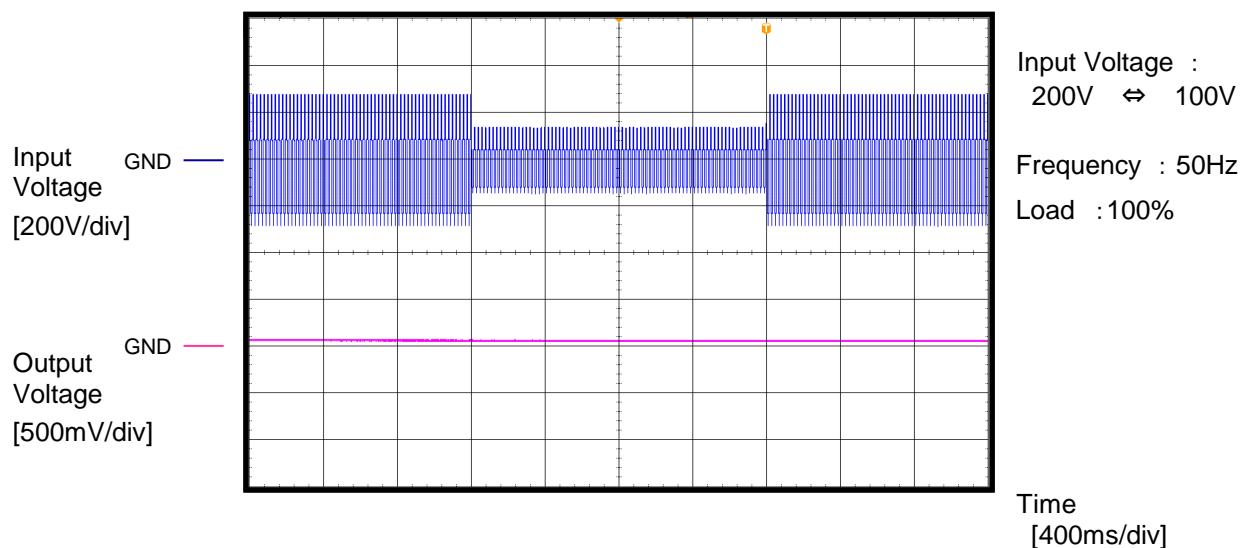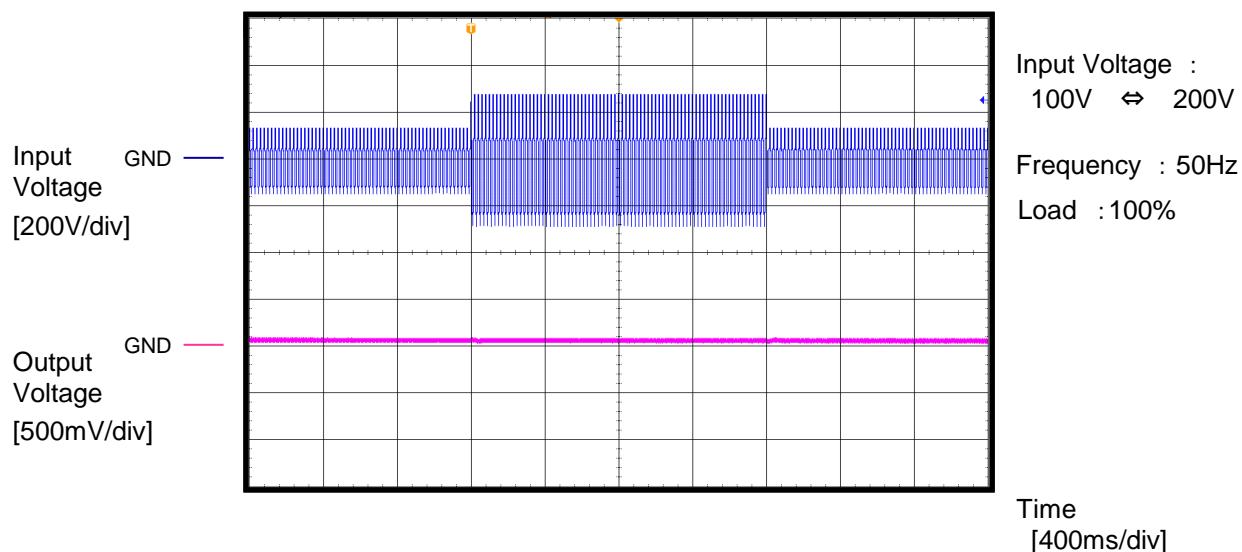




COSEL

Model	PBA100F-48	Temperature 25°C
Item	Over Voltage Protection	Testing Circuitry A
Object	_____	Input Voltage : 100V

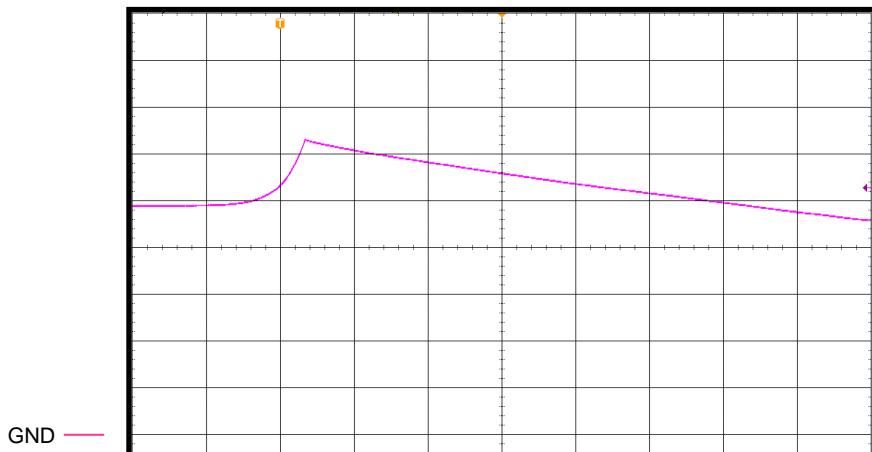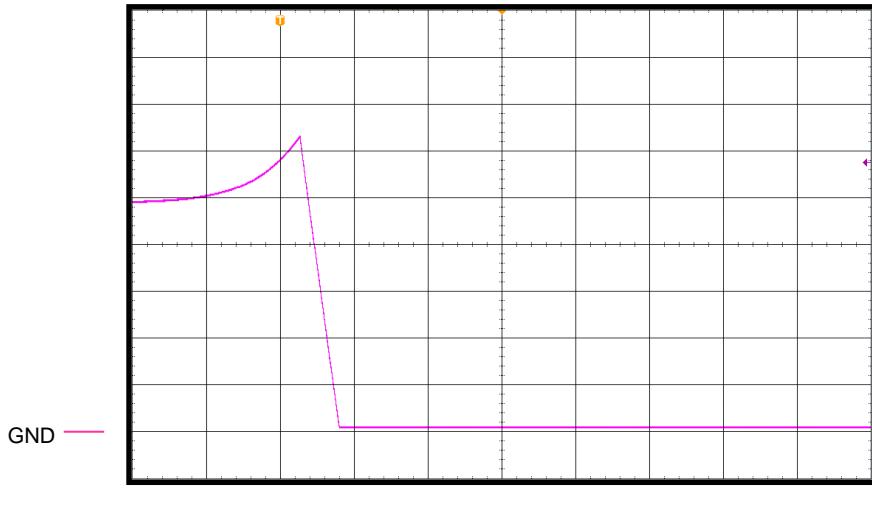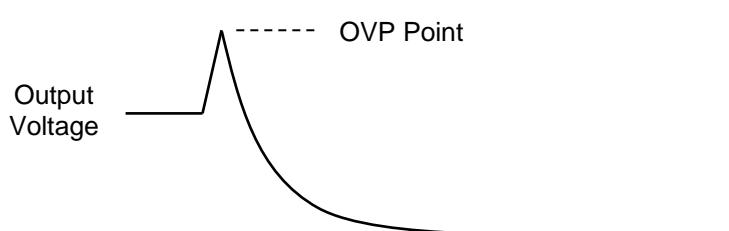Output
Voltage
[10V/div]Load : 0%
Overvoltage protection
value : 63.2VOutput
Voltage
[10V/div]Load : 100%
Overvoltage protection
value : 63.2V

COSEL

Model	PBA100F-48	Temperature	25°C
Item	Hiccup cycle (by Overcurrent Protection)	Testing Circuitry	A
Object	Load : Short		

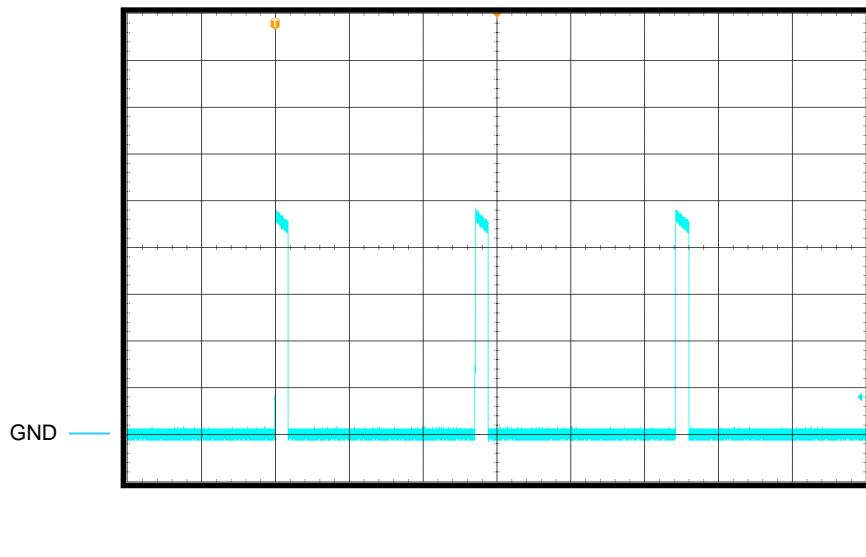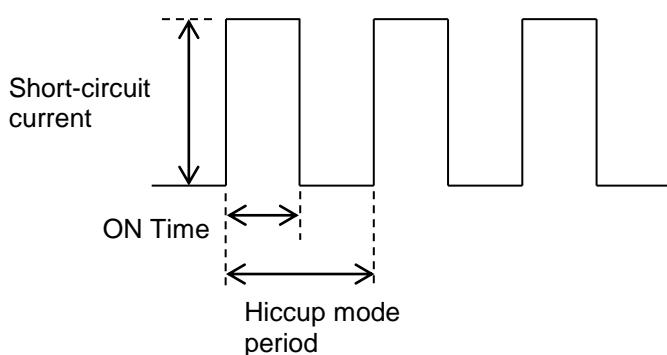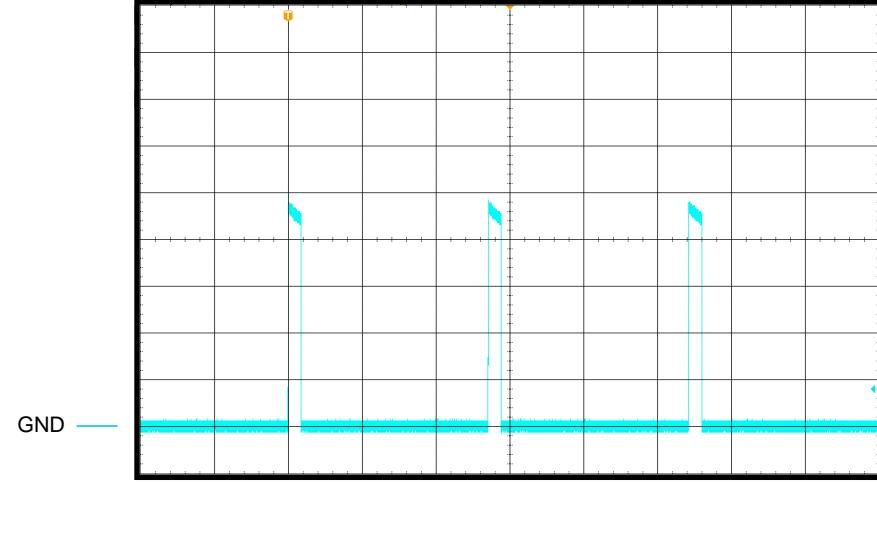Output
Current
[1A/div]Output
Current
[1A/div]

COSEL


Model	PBA100F-48
Item	Input voltage - Power consumption
Object	_____

Temperature 25°C
Testing Circuitry -

Load : 0%

2.Values

Input voltage [V]	Power consumption [W]
85	1.15
100	1.12
115	1.03
200	1.29
230	1.35
264	1.96

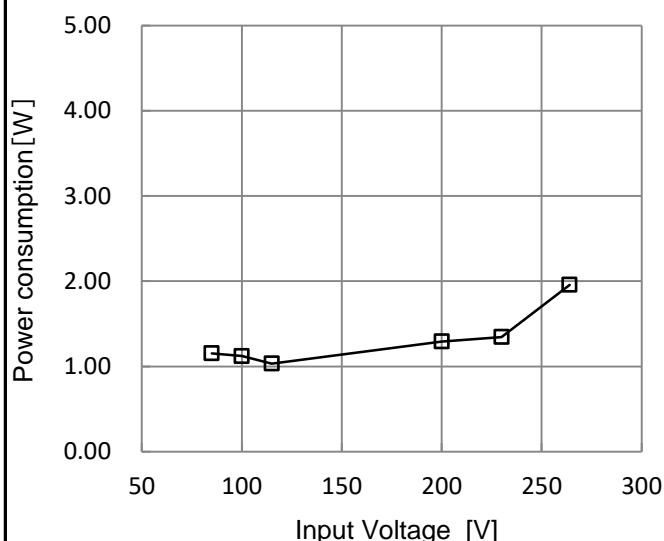

Reducing standby power is possible by OFF signal of the remote control.

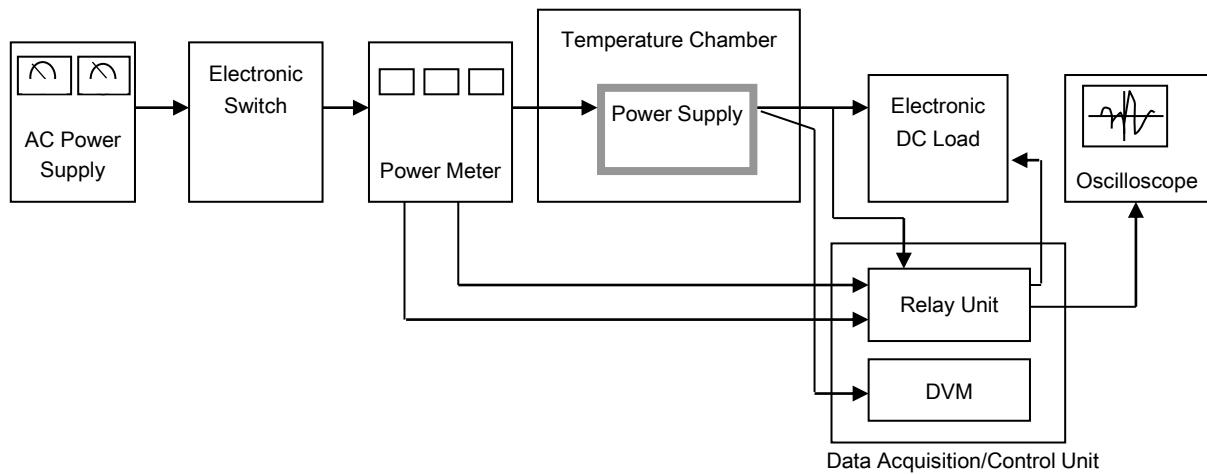


Figure A